


Series 2400-B Three-Line

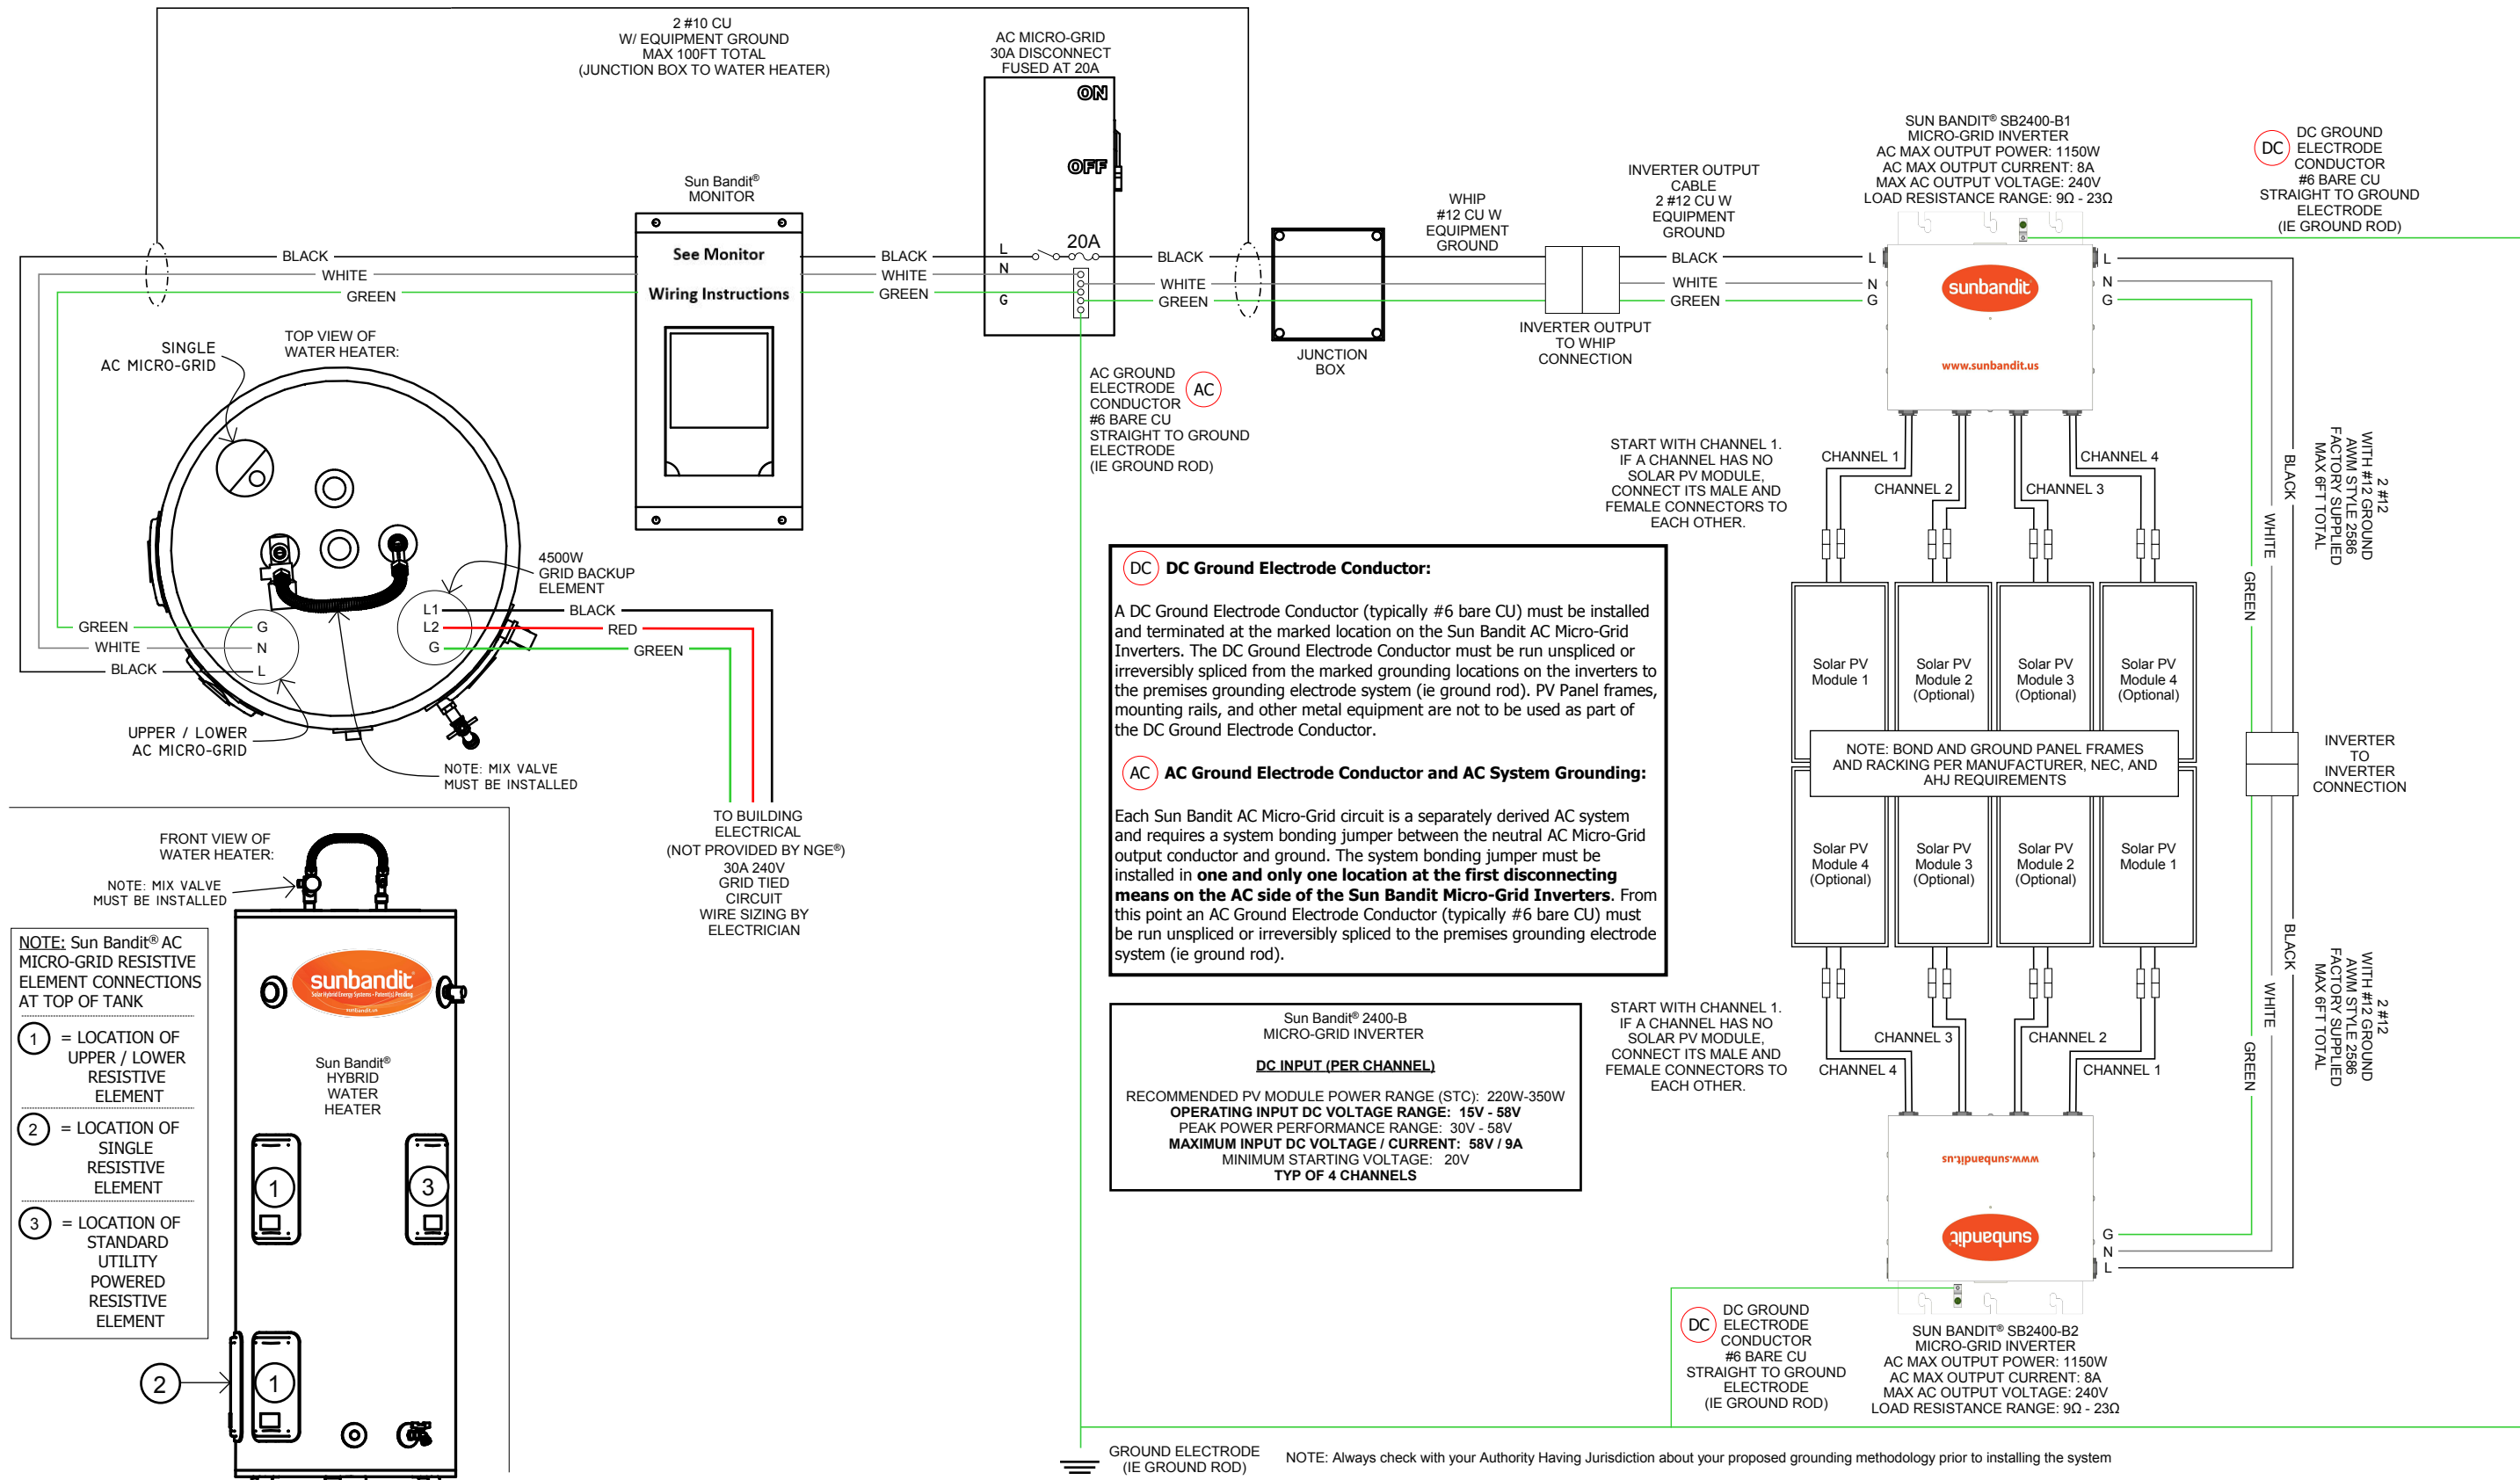

NOTE: ALL WORK TO BE PERFORMED BY QUALIFIED ELECTRICIANS. ALL WORK TO BE DONE PER AHJ AND UTILITY REQUIREMENTS. ALL INSTALLATION CONDITIONS TO BE FIELD VERIFIED FOR APPROPRIATENESS.

Version 180907

Series 2400-B THREE-LINE

